


# Tate Andale Standard Automatic Controls for Electrically-Operated Type KR, KB, KBF and I 260 Strainers

Electric-Operated Control Schematic

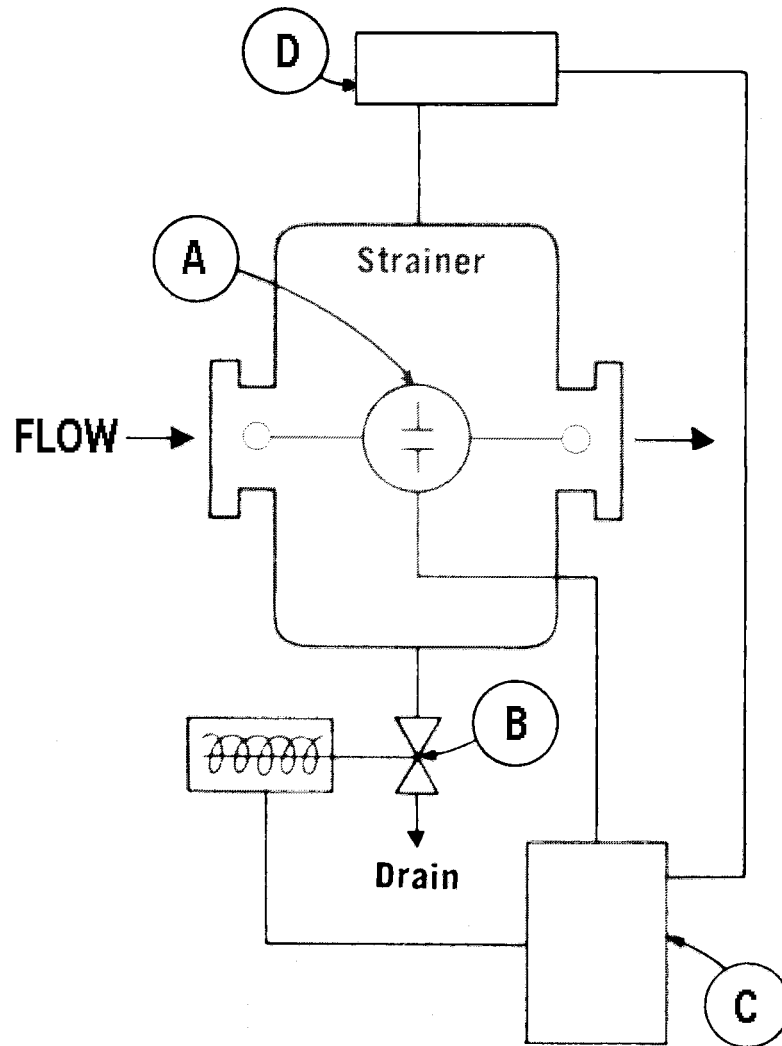

This control system is electric motor-driven and no control air supply is required. It is completely automatic, controlled by an impulse from a differential pressure switch across inlet and outlet nozzles.

When predetermined pressure drop is reached, a signal from the differential pressure switch starts the rotating element and opens the flushing valve for a minimum period of 30 seconds, or until the pressure drop has returned to normal.

A "Hands-off-Auto" selector switch permits changing from normal intermittent automatic operation to continuous back-flushing if desired. A momentary contact "Start" pushbutton permits manual override of the differential control switch.

**Services required:**


Motor drive—as required by customer  
 Control system—110 volt, single phase, 60 Hz

**Key:**

- (A)—Differential pressure switch
- (B)—Electric-operated flushing valve
- (C)—Control panel
- (D)—Gearmotor diverter valve drive

# Tate Andale Standard Automatic Controls for Type KR, KB, KBF and I 260 Strainers Air-Operated

## Air-Operated Control Schematic

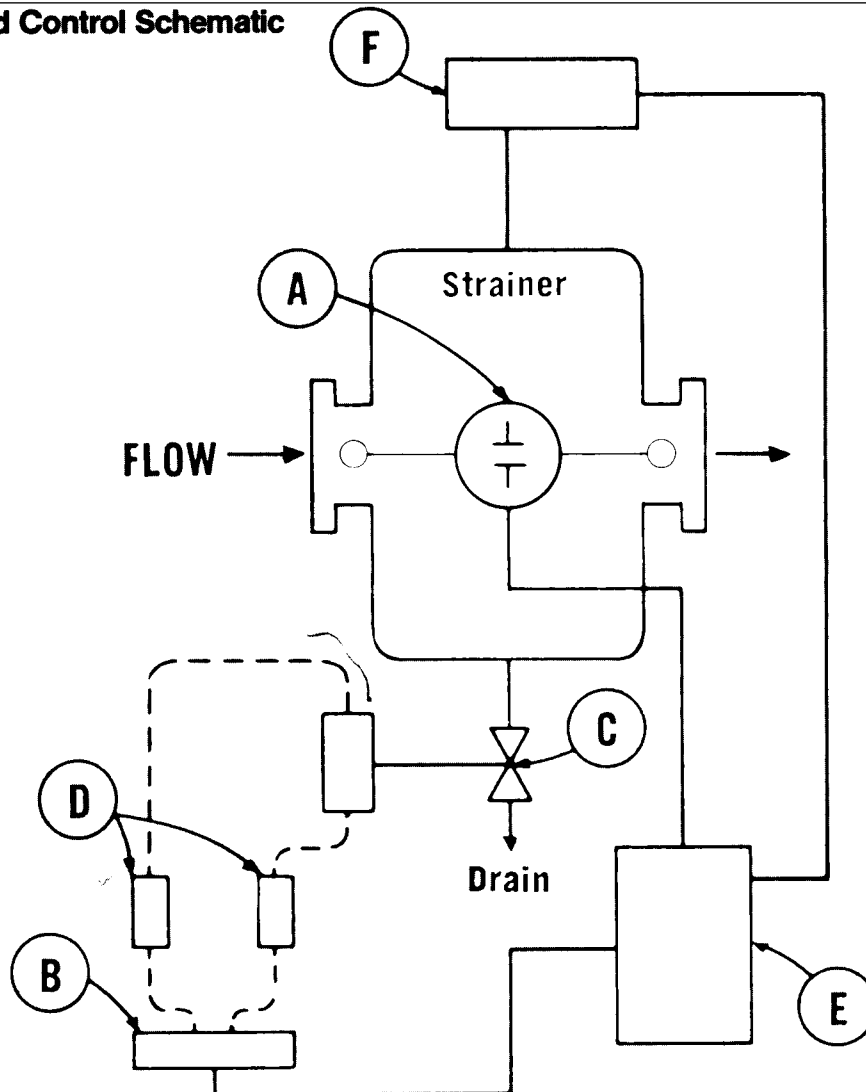

This is a completely automatic system with air-operated flushing valve controlled by an impulse from a differential pressure switch connected across the inlet and outlet nozzles of the strainer. When a predetermined pressure drop has been reached, a signal from the differential pressure control switch starts the rotating element and opens the flushing valve for a minimum period of 30 seconds, or until the pressure drop has returned to normal.

A "Hands-off-Auto" selector switch permits changing from normal intermittent

automatic operation to continuous back flushing if desired. A momentary contact "Start" pushbutton permits manual override for the differential control switch.

### Services required:

Motor drive—as required by customer  
Control system—110 volt, single phase, 60 Hz  
Flushing valve—60 to 100 PSIG clean air supply

### Key:

- (A)—Differential pressure switch
- (B)—Single solenoid 4-way air valve
- (C)—Air-operated flushing valve
- (D)—Flow control valves (2)
- (E)—Control panel
- (F) Gearmotor rotating element drive
- Pneumatic control lines

Both control systems provide a blow-down connection in addition to the backflush connection. This permits manual blow-down for removal of debris which may have accumulated in the bottom of the strainer. The blow-down gate valve (furnished by the purchaser) should be the same size as the blow-down connection on the strainer.